



### Special Features

- Wetted parts in acid-proof, stainless steel and PEEK
- Compact, food compatible, hygienic design
- Hygienic connections conform to 3-A standards, FDA demands and EHEDG guidelines
- Precise switching point without calibration
- Process temperature -40...200 °C
- Measures media with DK-values >1.5 (DK = Dielectrical Constant)
- Not influenced by foam
- LED switch indicator
- Maintenance free
- Suitable for media separation measurement
- Configurable by FlexProgrammer 9701
- ATEX approval for gas and dust
- WHG approval (leakage and overfill)



### Technical Data

Sensor	
Radiated signal	100...180 MHz
Process connection	Hygienic: G1/2, 3-A/DN38 or sliding connection
Adapters	Refer to page 5
Insulating material	PEEK Natura
Mechanical data	
Housing	Stainless Steel, W1.4301/AISI 304
Process connection	Stainless Steel, W1.4404/AISI 316 L
Amb. temperature	-40...85 °C
Process temperature	
Std. & 3-A/DN38	-40...115 °C (See curve 1)
Sliding connection	-40...200 °C (See curve 1)
< 1 hour, Tamb < 60 °C	-40...140 °C
Protection class	IP67 (IEC 529)
Media pressure (tested with water at 20°C)	Standard G½ hygienic < 100 bar 3-A DN38 < 40 bar Sliding connection < 16 bar
Vibrations	IEC 60068-2-6, GL test2
Installation	Any position
Electrical connection	
Cable gland M16	Plast or Nickel-plated brass
Plug M12	Nickel plated brass or stainless steel AISI 304
Other electrical data	
Power supply	12,5...36 VDC, 35 mA max.
Damping	0...10 sec.
Power-up time	<2 sec.
Hysteresis	± 1 mm
Repeatability	± 1 mm
Reaction time	0.1 sec. (100 mS)

### Approvals/conformities

Approvals/conformities EN 1935/2004, EN 10/2011, EN 2023/2006, EN 50155 Railway, 3-A, EHEDG, FDA, WHG (leakage and overfill) UL listed, E36692

### Disposal of product and packing

According to national laws or by returning to Baumer.

### EMC data

Immunity EN 61326

Emission EN 61326

### Ex data (ia)

Internal inductivity  $L_i \leq 10 \mu\text{H}$

Internal capacity  $C_i \leq 33 \text{ nF}$

Barrier data  $U \leq 30 \text{ VDC}$ ;  $I \leq 0.1 \text{ A}$ ;  $P \leq 0.75 \text{ W}$

### Approval Ex ia IIC T5, ATEX II 1G (See table 1)

Supply range 24...30 VDC

Temperature class T1...T5:  $-40 < T_{\text{amb}} < 85 \text{ °C}$

### Approval Ex tD A20 IP67 T100 °C, ATEX II 1D (See table 1)

Supply range 12,5...30 VDC

Temperature class T100 °C:  $-40 < T_{\text{amb}} < 85 \text{ °C}$

### Approval Ex nA II T5, ATEX II 3G (See table 1)

Supply range 12,5...30 VDC

Temperature class T1...T5:  $-40 < T_{\text{amb}} < 85 \text{ °C}$

### Output

Output (active) Max. 50 mA, short-circuit and high-temperature protected

Output type PNP, NPN or Digital output (Push-pull)

Output polarity See drawing

Active "Low" NPN and Digital output (-VDC +2.5V) ± 0.5V ; Rload 1 kOhm

Active "High" PNP and Digital output (VDC -2.5V) ± 0.5V ; Rload 1 kOhm


Off leak current ± 100 µA Max.

## Technical Data


### Factory Settings

Output	PNP, NPN or Digital
Measure	DK value >1,5
Damping	0.1 sec.


## Dimensional Drawings

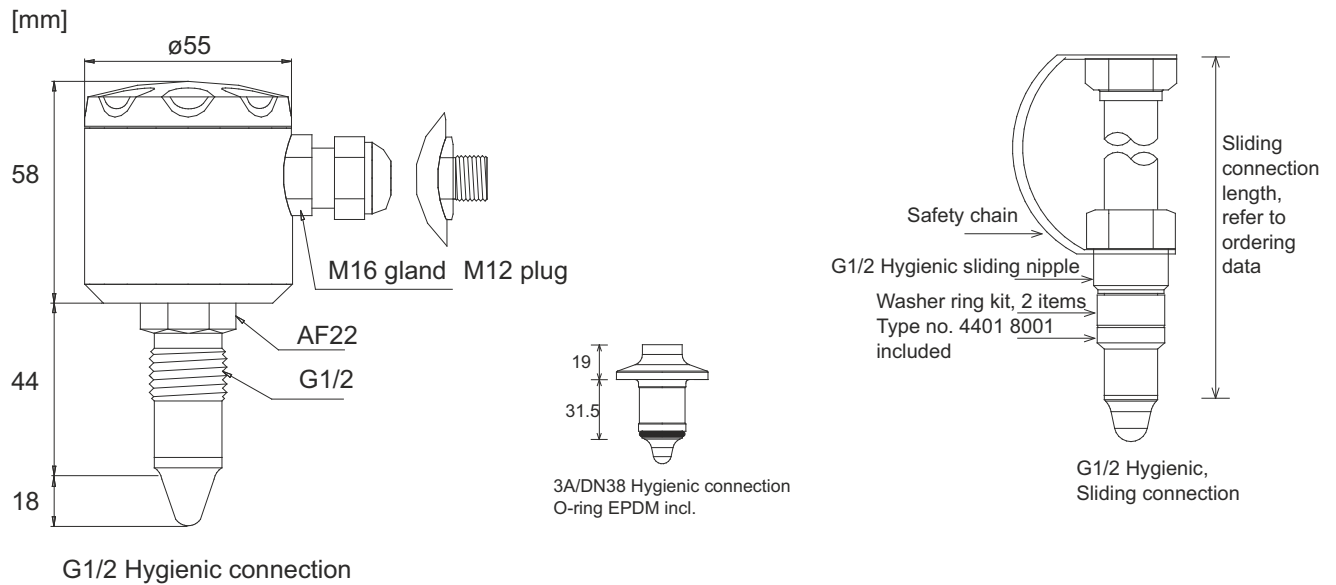

## Sliding connection load

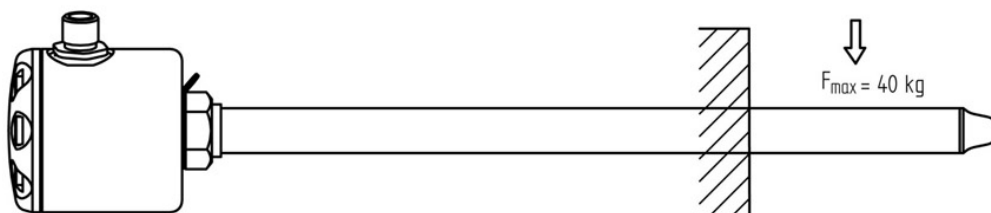


## Electrical Connection

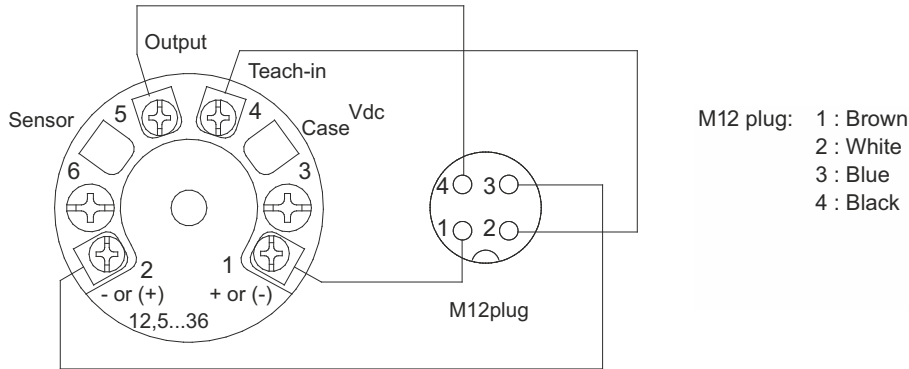


## Electrical Installation

### Normally Open


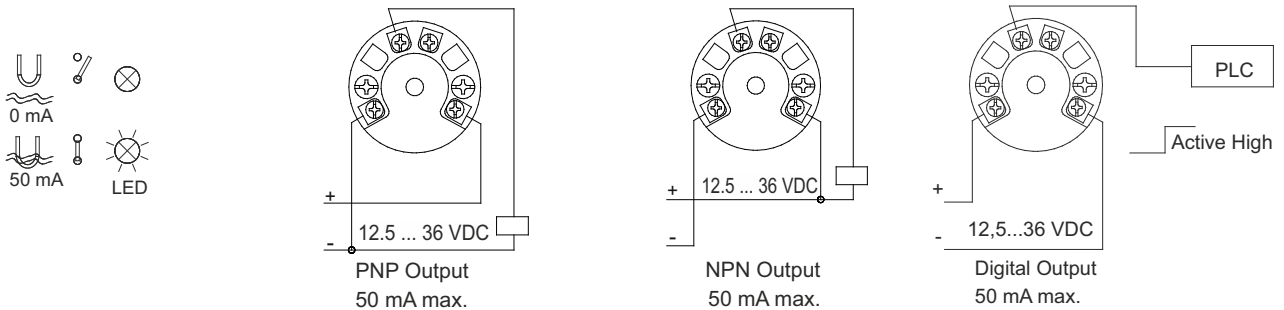


### Normally Closed

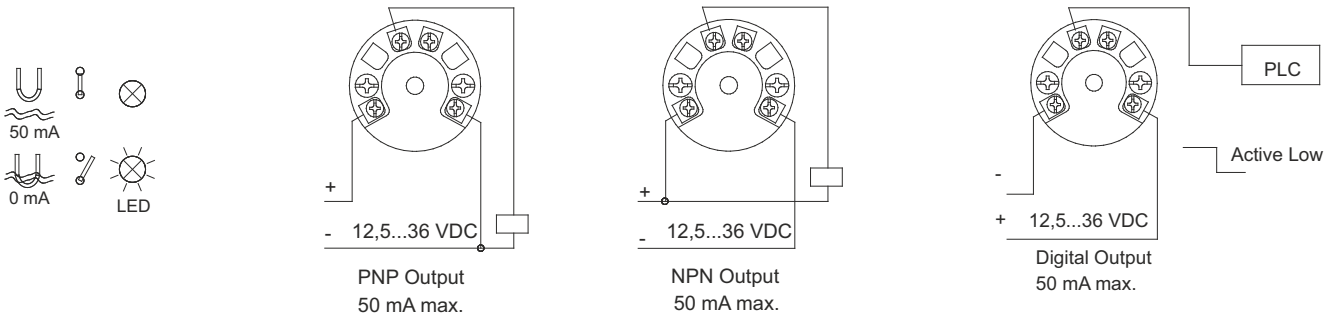

## Configuration

### FlexProgrammer 9701

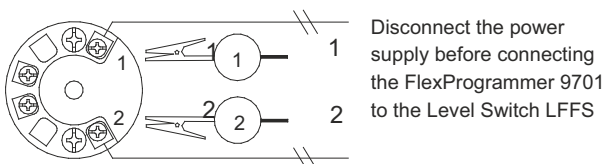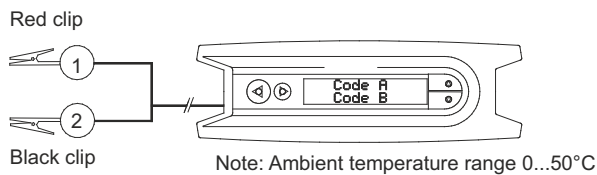


## Accessories



The FlexProgrammer 9701 is a dedicated tool to configure all Baumer configurable Flex-products

Type No.9701-0001 comprises:  
FlexProgrammer  
Cables  
CD with the FlexProgram software

## The Sliding Connection (Figure 1)

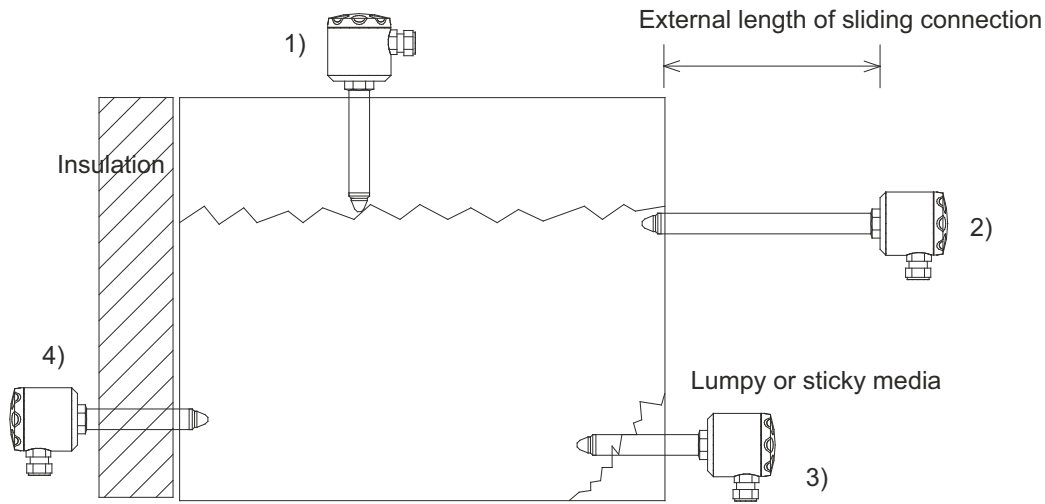

The drawing shows how the sliding connection can be used for at least 4 applications:

- 1) Mounted at the top of a tank to adjust to a maximum level.
- 2) Serving as a cooling neck in high media temperature applications.
- 3) Adjusted to place the sensor tip deeper inside the tank.
- 4) To reach in through insulation material.

It is essential that the max. ambience temperature for the electronics is never exceeded. For ATEX approved products please refer to table 1.

The working conditions for the sliding connection in different media temperatures and specified ambient temperatures can be found in curve 1.


Example, how to read Curve 1:

A 250 mm sliding connection is mounted in a tank with a total insert length of 150 mm. Hence the external length of the sliding connection will be  $250 - 150 = 100$  mm.

The media temperature will be max.  $160\text{ }^{\circ}\text{C}$ .


Read the x-axis at 100 mm on the y-axis at  $160\text{ }^{\circ}\text{C}$  and find that the ambient temperature must be kept below  $50\text{ }^{\circ}\text{C}$ . In case the radiated heat from the tank will cause a higher ambient temperature at the housing efficient insulation of the tank must be established

## Media Temperature versus External Length of Sliding Connection (Curve 1)

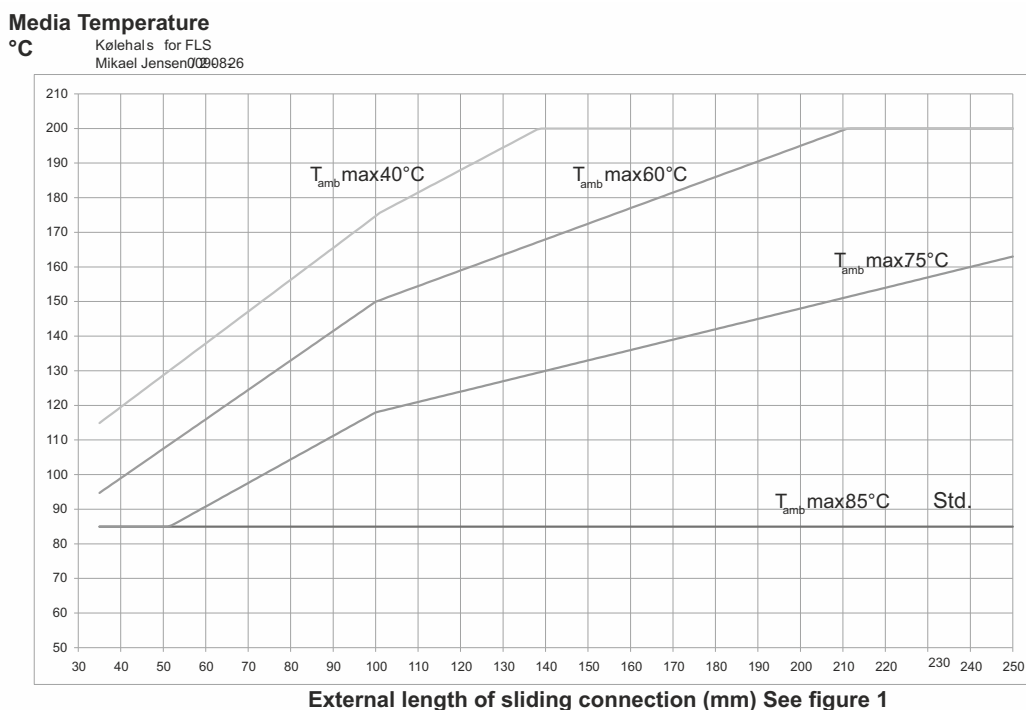

NB: + 3A/DN38 = 35 mm external length

## Accessories - Overview

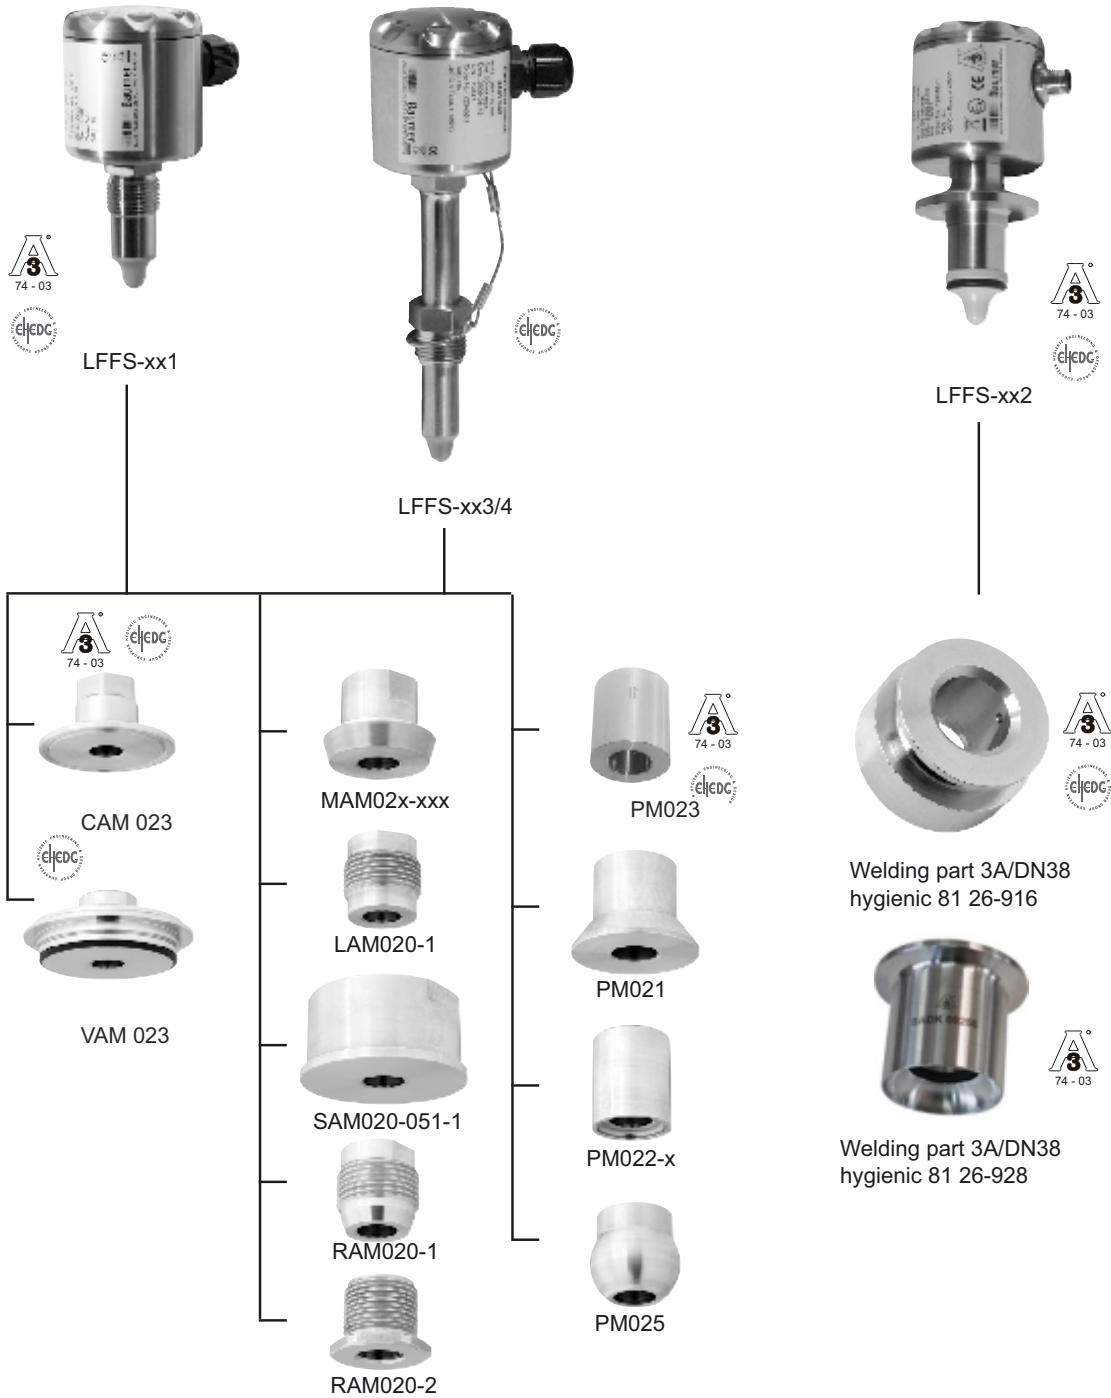

### Ex ia G - Installation

A Level Switch LFFS-1xx is Ex ia IIC T5, ATEX II 1G approved for application in hazardous areas in accordance with the current EU directives. The product must be installed in accordance with prevailing guidelines for zone 0 with a barrier.

### Ex tD - Installation

A Level Switch LFFS-2xx is Ex tD A20 IP67 T100°C, ATEX II 1D approved for application in hazardous areas in accordance with the current EU-directives. The product must be installed in accordance with prevailing guidelines for zone 20 without a barrier.

### Ex ia G, Ex nA G - Installation

A Level Switch LFFS-3xx is Ex nA II T5, ATEX II 3G approved for application in hazardous areas in accordance with the current EU-directives. The product must be installed in accordance with prevailing guidelines for zone 2 without a barrier.

### Ex ia IIC T5, ATEX II 1G - Installation

A Level Switch LFFS-1xx is Ex ia IIC T5, ATEX II 1G approved for application in hazardous areas in accordance with the current EU directives. The product must be installed in accordance with prevailing guidelines for zone 0 with a barrier.

A certified Ex ia or isolation barrier with the maximum values  $U_{max} = 30$  VDC ;  $I_{max} = 0.1$  A ;  $P_{max} = 0.75$  W must be used.

### Conditions for Ex-Certification (Table 1)


Connection Type	Tamb °C	Media Temp. max. °C	Note
Std. & 3-A/DN38	-40...85	85	
	-40...60	95	{2}
	-40...40	115	{2}
Sliding 100 mm	-40...85	85	
	-40...60	150	{2}
	-40...40	175	{2}
Sliding 250 mm	-40...85	85	
	-40...60	195	{2}
	-40...40	200	{2} {3}

Note {2}: Provided that the sensor tip at the instrument is the only part in contact with the media.

Note {3}: Max. allowed media temperature.

### Ex-data

Supply range	24...30 VDC
Temperature class	T1...T5: See table 1
Internal inductivity	$L_i < 10 \mu\text{H}$
Internal capacity	$C_i < 33 \text{ nF}$
Barrier data	$U < 30$ VDC ; $I < 0.1$ A ; $P < 0.75$ W

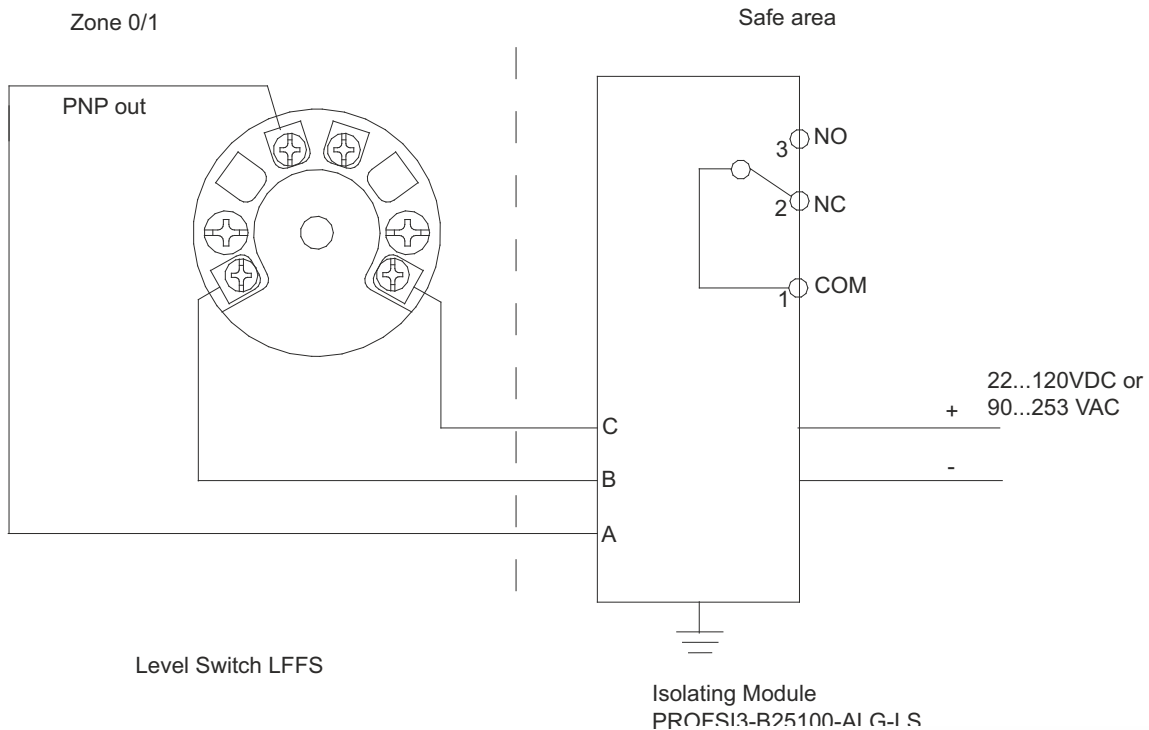

**NB: For PNP output the PROFSI3-B25100-ALG-LS barrier must be used.**


**Isolating Module**  
**PROFSI3-B25100-ALG-LS**

## Ex tD A20 IP67 T100, ATEX II 1D - Installation

A Level Switch LFFS-2xx is Ex tD A20 IP67 T100°C, ATEX II 1D approved for application in hazardous areas in accordance with the current EU-directives. The product must be installed in accordance with prevailing guidelines for zone 20 without a barrier.

### Ex-data

Supply range	12,5...30 VDC, max 100 mA
Temperature class	T100: See table 1

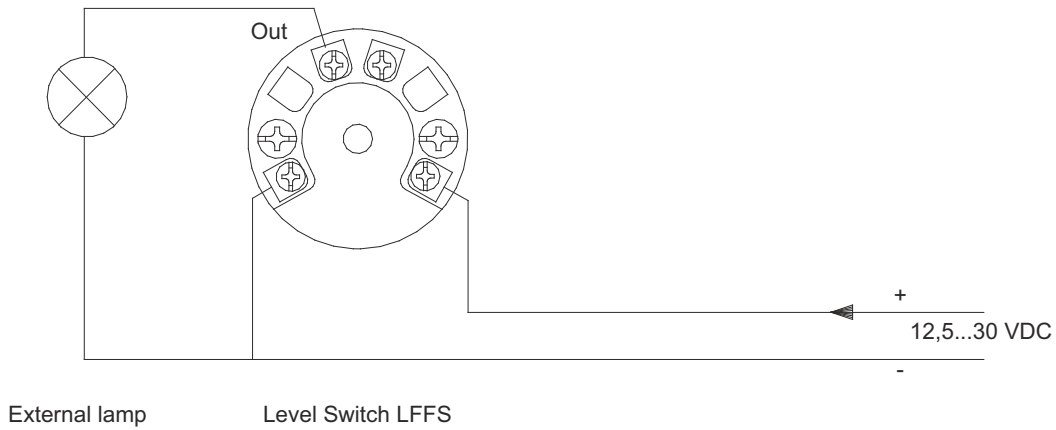


## Ex nA II T5, ATEX II 3G - Installation

A Level Switch LFFS-3xx is Ex nA II T5, ATEX II 3G approved for application in hazardous areas in accordance with the current EU-directives. The product must be installed in accordance with prevailing guidelines for zone 2 without a barrier.

### Ex-data

Supply range	12,5...30 VDC, Max. 0.1A
Temperature class	T1...T5: See table 1

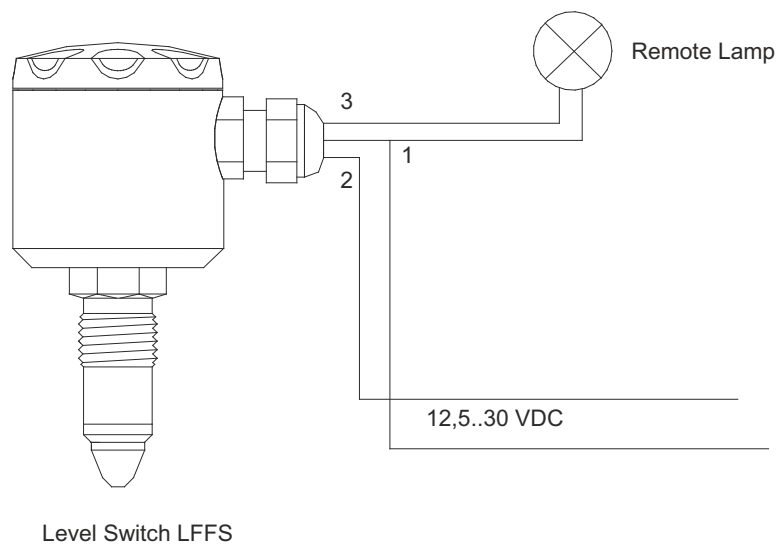

## Ordering details

Model				
Level Switch		LFFS		
<b>Safety</b>	5' digit			
Standard				0
Ex ia IIC T5, ATEX II 1G (Gas) *				1
Ex tD A20 IP67 T100 °C, ATEX II 1D (Dust)				2
Ex nA II T5, ATEX II 3G				3
UL listed, E365692				A
<b>Electrical Connection</b>	6' digit			
Plug, M12, Nickel plated brass				1
Cable gland, M16 brass				2
Cable gland, M16 Polyamid				3
Plug, M12, stainless				4
<b>Process Connection</b>	7' digit			
G1/2, PEEK tip <sup>(1)</sup>				1
3-A/DN38 Hygienic connection <sup>(1)</sup>				2
G1/2, PEEK tip, sliding connection, 100 mm adjustable, incl. washer ring kit 4401 8001 <sup>(2)</sup>				3
G1/2, PEEK tip, sliding connection, 250 mm adjustable, incl. washer ring kit 4401 8001 <sup>(2)</sup>				4
<b>Configuration</b>	8' digit			
No configuration				0
Configuring according to customer specification				C

\* For PNP output the barrier module PFOFSI3-B25100-ALG-LS is required for functional purposes.


The washer ring kit for sliding connection, type no. 4401 8001  
Can be ordered separately.  
Baumer recommended to replace this kit if deformed.

## 3-A certificate / EHEDG certificate

<sup>(1)</sup> The 3-A mark and the EHEDG certificate is valid only when the product is mounted in a 3-A marked or EHEDG certified counter part and installed according to the installation manual. Use also a 3-A marked O-ring or gasket if relevant. The 3-A marked products conforms to the 3-A Sanitary Standard criteria. Materials and surfaces fulfill the FDA demands and are certified by EHEDG.

<sup>(2)</sup> Certified by EHEDG. Fulfills the FDA demand.  
EPDM O-rings supplied with 3-A marked products are conform to Sanitary Standard Class II (8% milk fat max.)  
EPDM gaskets supplied with 3-A marked products are conform to Sanitary Standard Class I (8% milk fat max.)  
Refer to the 3-A marked counter parts in the data sheet "Accessories Universal".

## Level Switch LFFS, example

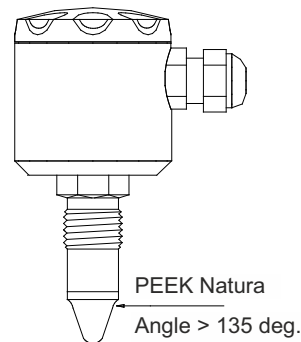

## Authorised Dealer



*NK Instruments Pvt. Ltd.*

B-501/504, 5th floor, Raunak Arcade, Near THC Hospital, Gokhale Road, Naupada,  
Thane(W) 400602. Maharashtra INDIA      Telefax Nos.: 91-22-25301330 / 31 / 32  
E-Mail: sales@nkinstruments.com      Web: http://www.nkinstruments.com  
Skype: nitinkelkarskype      Gtalk: nkinstruments2006

